

# SIEMENS

## SIMATIC

ET 200S distributed I/O  
2AO U HF analog electronic module  
(6ES7135-4LB02-0AB0)

Manual

Preface

---

Properties

---

1

Parameters

---

2

Diagnostics

---

3

Analog value representation

---

4

Connecting

---

5

## Safety Guidelines

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

<b>⚠ DANGER</b>
indicates that death or severe personal injury <b>will</b> result if proper precautions are not taken.
<b>⚠ WARNING</b>
indicates that death or severe personal injury <b>may</b> result if proper precautions are not taken.
<b>⚠ CAUTION</b>
with a safety alert symbol, indicates that minor personal injury can result if proper precautions are not taken.
<b>CAUTION</b>
without a safety alert symbol, indicates that property damage can result if proper precautions are not taken.
<b>NOTICE</b>
indicates that an unintended result or situation can occur if the corresponding information is not taken into account.

If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

## Qualified Personnel

The device/system may only be set up and used in conjunction with this documentation. Commissioning and operation of a device/system may only be performed by **qualified personnel**. Within the context of the safety notes in this documentation qualified persons are defined as persons who are authorized to commission, ground and label devices, systems and circuits in accordance with established safety practices and standards.

## Prescribed Usage

Note the following:

<b>⚠ WARNING</b>
This device may only be used for the applications described in the catalog or the technical description and only in connection with devices or components from other manufacturers which have been approved or recommended by Siemens. Correct, reliable operation of the product requires proper transport, storage, positioning and assembly as well as careful operation and maintenance.

## Trademarks

All names identified by ® are registered trademarks of the Siemens AG. The remaining trademarks in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

## Disclaimer of Liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

# Preface

## Purpose of the manual

This manual supplements the *ET 200S Distributed I/O System* Operating Instructions. General functions for the ET 200S are described in the *ET 200S Distributed I/O System* Operating Instructions.

The information in this document along with the operating instructions enables you to commission the ET 200S.

## Basic knowledge requirements

To understand these operating instructions you should have general knowledge of automation engineering.

## Scope of the manual

This manual applies to this ET 200S module. It describes the components that are valid at the time of publication.

## Recycling and disposal

Thanks to the fact that it is low in contaminants, this ET 200S module is recyclable. For environmentally compliant recycling and disposal of your electronic waste, please contact a company certified for the disposal of electronic waste.

## Additional support

If you have any questions relating to the products described in these operating instructions, and do not find the answers in this document, please contact your local Siemens representative.

<http://www.siemens.com/automation/partner>

The portal to our technical documentation for the various SIMATIC products and systems is available at:

<http://www.siemens.com/automation/simatic/portal>

The online catalog and ordering system are available at:

<http://www.siemens.com/automation/mall>

## Training center

We offer courses to help you get started with the ET 200S and the SIMATIC S7 automation system. Please contact your regional training center or the central training center in D - 90327, Nuremberg, Germany.

Phone: +49 (911) 895-3200.

<http://www.siemens.com/sitrain>

## Technical Support

You can reach technical support for all A&D projects

- using the support request web form:  
<http://www.siemens.com/automation/support-request>
- Phone: + 49 180 5050 222
- Fax: + 49 180 5050 223

For more information about our technical support, refer to our Web site at

<http://www.siemens.de/automation/service>

## Service & Support on the Internet

In addition to our documentation services, you can also make use of our comprehensive online knowledge base on the Internet.

<http://www.siemens.com/automation/service&support>

There you will find:

- Our Newsletter, which constantly provides you with the latest information about your products.
- The right documentation for you using our Service & Support search engine.
- The bulletin board, a worldwide knowledge exchange for users and experts.
- Your local contact for Automation & Drives in our contact database.
- Information about on-site services, repairs, spare parts. Lots more can be found on our "Services" pages.

# Table of contents

	<b>Preface</b> .....	<b>3</b>
<b>1</b>	<b>Properties</b> .....	<b>7</b>
1.1	2AO U HF analog electronic module (6ES7135-4LB02-0AB0) .....	7
<b>2</b>	<b>Parameters</b> .....	<b>11</b>
2.1	Parameters.....	11
<b>3</b>	<b>Diagnostics</b> .....	<b>13</b>
3.1	Diagnostics using LED display.....	13
3.2	Error types.....	14
<b>4</b>	<b>Analog value representation</b> .....	<b>15</b>
4.1	Introduction .....	15
4.2	Analog value representation for measuring range with SIMATIC S7 .....	15
4.3	Output ranges .....	16
4.4	Effect on analog value representation .....	17
4.4.1	Effect of the supply voltage and the operating state on analog output values .....	17
4.4.2	Effect of the value range on the 2AO U HF analog output .....	18
<b>5</b>	<b>Connecting</b> .....	<b>19</b>
5.1	Connecting analog outputs .....	19
	<b>Index</b> .....	<b>21</b>



## Properties

### 1.1 2AO U HF analog electronic module (6ES7135-4LB02-0AB0)

#### Properties

- 2 outputs for voltage output
- Output range:
  - $\pm 5$  V, resolution 15 bits + sign
  - $\pm 10$  V, resolution 15 bits + sign
  - 1 V to 5 V, resolution 15 bits
- Isolated from the load voltage L+
- Supports isochronous operation
  - Minimum time for the synchronous DP cycle ( $T_{DPmin}$ ): 0.7 ms
  - Minimum conversion time of the output modules: ( $T_{WAmin}$ ): 0.5 ms
- Supports I&M functions

#### General terminal assignment

---

##### Note

Terminals A4, A8, A3 and A7 are only available on certain terminal modules.

---

Terminal assignment for 2AO U HF (6ES7135-4LB02-0AB0)				
Terminal	Assignment	Terminal	Assignment	Notes
1	QV <sub>0</sub>	5	QV <sub>1</sub>	<ul style="list-style-type: none"> <li>• QV<sub>n</sub>: Analog output voltage, Channel n</li> <li>• S<sub>n+</sub>: Tracer line positive, Channel n</li> <li>• S<sub>n-</sub>: Tracer line negative, Channel n</li> <li>• M<sub>ana</sub>: Ground of the module</li> <li>• AUX1: Protective-conductor terminal or potential bus (freely usable up to 230 VAC)</li> </ul>
2	S <sub>0+</sub>	6	S <sub>1+</sub>	
3	M <sub>ana</sub>	7	M <sub>ana</sub>	
4	S <sub>0-</sub>	8	S <sub>1-</sub>	
A4	AUX1	A8	AUX1	
A3	AUX1	A7	AUX1	

Usable terminal modules

Usable terminal modules for 2AO U HF (6ES7135-4LB02-0AB0)		
TM-E15C26-A1 (6ES7193-4CA50-0AA0)	TM-E15C24-01 (6ES7193-4CB30-0AA0)	← Spring terminal
TM-E15S26-A1 (6ES7193-4CA40-0AA0)	TM-E15S24-01 (6ES7193-4CB20-0AA0)	← Screw-type terminal
TM-E15N26-A1 (6ES7193-4CA80-0AA0)	TM-E15N24-01 (6ES7193-4CB70-0AA0)	← Fast Connect
		<p>Wiring examples</p> <div style="display: flex; justify-content: space-around;"> <div style="text-align: center;"> <p>2-wire</p> </div> <div style="text-align: center;"> <p>4-wire</p> </div> </div>

Block diagram

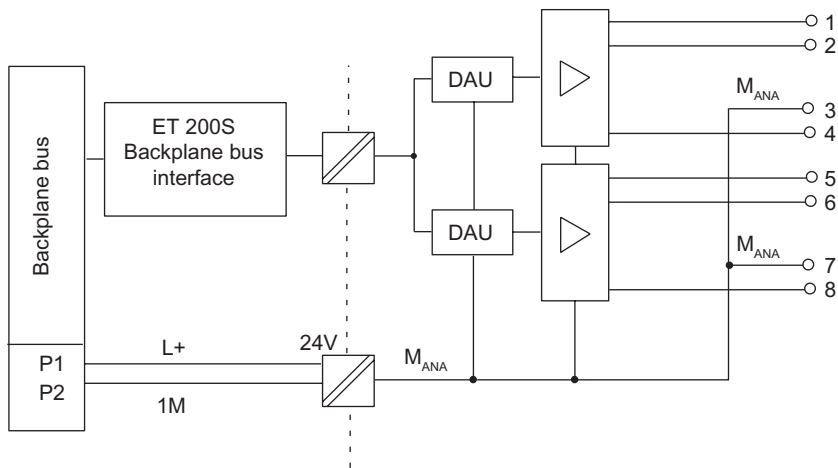


Figure 1-1 Block diagram of the 2AO U HF



## 2AO U HF technical specifications (6ES7135-4LB02-0AB0)

<b>Dimensions and weight</b>	
Width (mm)	15
Weight	Approx. 40 g
<b>Module-specific data</b>	
Supports isochronous operation	Yes
Supports I&M functions	Yes
Number of outputs	2
Cable length	
• Shielded	Max. 200 m Max. 100 m where $T_{WA} < 2$ ms
Analog value representation	S5 and S7 format
Parameter length	7 bytes
Address space	4 bytes
<b>Voltages, currents, potentials</b>	
Rated load voltage L+ (from the power module)	24 VDC
• Reverse polarity protection	Yes
Electrical isolation	
• Between the channels and backplane bus	Yes
• Between the channels and load voltage L+	Yes
• Between the channels	No
Permissible potential difference	
• Between $M_{ANA}$ and the central grounding point ( $U_{iso}$ )	75 V DC/60 V AC
Insulation tested	500 VDC
Current consumption	
• From load voltage L+	Max. 80 mA
Power dissipation of the module	Max. 1.2 W
<b>Status, interrupts, diagnostics</b>	
Diagnostics function	
• Group error display	Red "SF" LED
• Diagnostic information readable	Supported
Substitute values can be applied	Yes, parameterizable
<b>Analog value generation</b>	
Cycle time per module	0.5 ms
Resolution (including overshoot range)	$\pm 5$ V/15 bits + sign $\pm 10$ V/15 bits + sign 1 V to 5 V/15 bits
Settling time	
• For resistive load	0.3 ms
• For capacitive load	0.5 ms
• For inductive load	0.5 ms

Properties

1.1 2AO U HF analog electronic module (6ES7135-4LB02-0AB0)

Suppression of interference, limits of error	
Crosstalk between the outputs	Min. -60 dB
Operational limit	± 0,1 %
Intrinsic error limit	± 0,05 %
Temperature error (with reference to the output range)	±0.003%/K
Linearity error (with reference to the output range)	± 0,01 %
Repeatability (in steady state at 25°C with reference to output range)	± 0,01 %
Transmitter selection data	
Output range (rated value)	±5 V ±10 V 1 V to 5 V
Load impedance (in the rated range of the output)	
• At voltage outputs	Min. 1.0 kΩ
• Capacitive load	Max. 0.5 μF
Voltage output	
• Short circuit protection	yes
• Short circuit voltage	approx. 25 mA
Destruction limit against voltages/currents applied from outside	
• Voltage at the outputs to M <sub>ANA</sub>	Max. 15 V continuous; 75 V for max. 1 ms (sampling ratio 1:20)
Connection of actuators	
• Voltage output	Possible, without compensation of the line resistances
• 2-wire connection	Possible
• 4-wire connection	Possible

I&M functions

The I&M data can be read from the module using interface modules with the following order numbers or firmware/product versions (or higher):

Interface module	Order number	Firmware version	Product version
IM151-1 HIGH FEATURE	6ES7151-1BA01-0AB0	V2.0	02
IM151-3 PN	6ES7151-3AA20-0AB0	V4.0	01
IM151-3 PN HIGH FEATURE	6ES7151-3AA20-0AB0	V4.0	01
IM151-3 PN FO	6ES7151-3BB21-0AB0	V4.0	01

Note

Using the module after an IM151-7 CPU

If the module is positioned after an IM151-7 CPU, it outputs the last values before a RUN-STOP transition, provided no values were output by the user program after the STOP-RUN transition.

Take this into account when programming the control function startup (OB100 or OB1).

# Parameters

## 2.1 Parameters

Table 2-1 Parameters for analog output module


2AO U HF	Range of values	Default setting	Applicability
Group diagnostics (parameter assignment error, internal error)	<ul style="list-style-type: none"> <li>• Disable</li> <li>• Enable</li> </ul>	Disable	Module
Diagnostics: Short circuit to M <sub>1</sub>	<ul style="list-style-type: none"> <li>• Disable</li> <li>• Enable</li> </ul>	Disable	Channel
Response to CPU/master STOP	<ul style="list-style-type: none"> <li>• No output current or voltage</li> <li>• Substitute a value</li> <li>• Keep last value</li> </ul>	No output current or voltage	Module
Type/range of output	<ul style="list-style-type: none"> <li>• Deactivated</li> <li>• 1 to 5 V</li> <li>• <math>\pm 10</math> V</li> </ul>	$\pm 10$ V	Channel
Substitute value <sup>2</sup>	To 65,535 (value range must lie within the nominal range)	<ul style="list-style-type: none"> <li>• <math>\pm 10</math> V: 0 V</li> <li>• <math>\pm 5</math> V: 0 V</li> <li>• 1 to 5 V: 1 V</li> </ul>	Channel
<p><sup>1</sup> No diagnostics detection between -0.296 V and +0.296 V</p> <p><sup>2</sup> If there is no voltage being supplied to the interface module or COMPACT module but the supply to the analog output modules continues, the substitute values that have been assigned parameters are output. Substitute values must be within the nominal range. You can assign values from -27,648 to +27,648 as parameters (when assigning parameters using the GSD file).</p>			



## Diagnostics

### 3.1 Diagnostics using LED display

#### LED display

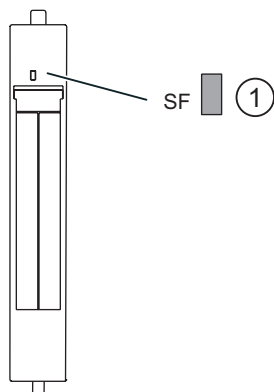

① Batch error (red)

#### Status and error displays

Event (LED)	Cause	Remedy
SF		
On	No configuration or incorrect module plugged in. No load voltage present There is a diagnostic message.	Check the parameter assignment. Check the load voltage. Evaluate the diagnostics.

## 3.2 Error types

### Analog output module error types

Table 3-1 Error types

Error type		Meaning	Remedy
16 <sub>D</sub>	10000: Parameter assignment error	Module cannot use the parameter for the channel: Inserted module does not match the one configured. Incorrect parameter assignment.	Correct the configuration (align actual and set configuration). Correct the parameter assignment (wire break diagnostics only parameterized for the permitted measuring ranges).
9 <sub>D</sub>	01001: Error	Internal module error has occurred (diagnostic message on channel 0 applies to the entire module).	Replace the module.
1 <sub>D</sub>	00001: Short circuit	Short circuit of the final controlling element supply.	Correct the process wiring.

## Analog value representation

### 4.1 Introduction

#### Electronic modules with analog outputs

With the electronic modules with analog outputs, digital values set by a controller can be converted to a corresponding analog signal (current) in an analog output module and used to control suitable actuators (setpoint input for speed controllers, temperature controllers and similar).

### 4.2 Analog value representation for measuring range with SIMATIC S7

#### Analog value representation

With the same nominal range, the digitized analog value is the same for input and output values. Analog values are represented in two's complement.

The following table shows the analog value representation of the analog electronic modules.

Table 4-1 Analog value representation (SIMATIC S7 format)

Resolution	Analog value															
Bit number	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Significance of the bits	S	$2^{14}$	$2^{13}$	$2^{12}$	$2^{11}$	$2^{10}$	$2^9$	$2^8$	$2^7$	$2^6$	$2^5$	$2^4$	$2^3$	$2^2$	$2^1$	$2^0$

#### Sign

The sign (S) of the analog value is always in bit number 15:

- "0" → +
- "1" → -

4.3 Output ranges

Output value

The following table shows the representation of the binary analog values and the corresponding decimal and hexadecimal representation of the units of the analog values.

The table below shows the resolutions 11, 12, 13, and 15 bit + sign. Each analog value is entered left aligned in the ACCU. The bits marked with "x" are set to "0".

Table 4-2 Output values (SIMATIC S7 format)

Resolution in bits	Units		Analog value	
	Decimal	Hexadecimal	High byte	Low byte
11+S	16	10 <sub>H</sub>	S 0 0 0 0 0 0 0	0 0 1 x x x x
12+S	8	8 <sub>H</sub>	S 0 0 0 0 0 0 0	0 0 0 1 x x x
13+S	4	4 <sub>H</sub>	S 0 0 0 0 0 0 0	0 0 0 0 1 x x
15 + sign	1	1 <sub>H</sub>	S 0 0 0 0 0 0 0	0 0 0 0 0 0 1

4.3 Output ranges

Voltage output ranges: ±5 V and ±10 V

Table 4-3 SIMATIC S7 format: Output range ±5 V and ±10 V

Output range ±5 V	Output range ±10 V	Units		Range
0	0	> 32511	> 7EFF <sub>H</sub>	Overflow
5,8800	11,7589	32511	7EFF <sub>H</sub>	Overshoot range
:	:	:	:	
5,0002	10,0004	27649	6C01 <sub>H</sub>	Nominal range
5,0000	10,0000	27648	6C00 <sub>H</sub>	
3,7500	7,5000	20736	5100 <sub>H</sub>	
:	:	:	:	
-3,7500	- 7,5000	-20736	AF00 <sub>H</sub>	
-5,0000	- 10,0000	-27648	9400 <sub>H</sub>	Underrange
-5,0002	- 10,0004	-27649	93FF <sub>H</sub>	
:	:	:	:	
-5,8800	- 11,7589	-32512	8100 <sub>H</sub>	Underflow
0	0	< -32512	< 8100 <sub>H</sub>	



## Voltage output ranges: 1 to 5 V

Table 4-4 SIMATIC S7 format: Output ranges 1 to 5 V

Output range 1 to 5 V	Units		Range
	Decimal	Hexadecimal	
0	> 32511	> 7EFF <sub>H</sub>	Overflow
5,7000	32511	7EFF <sub>H</sub>	Overshoot range
:	:	:	
5,0002	27649	6C01 <sub>H</sub>	Nominal range
5,0000	27648	6C00 <sub>H</sub>	
:	:	:	
1,0000	0	0 <sub>H</sub>	Underrange
0,9998	-1	FFFF <sub>H</sub>	
:	:	:	
0	-6912	E500 <sub>H</sub>	Underflow
0	< -6913	< E4FF <sub>H</sub>	

## 4.4 Effect on analog value representation

### 4.4.1 Effect of the supply voltage and the operating state on analog output values

The output values of the analog modules are dependent on the supply voltage for electronics/encoders and on the operating state of the PLC (CPU of the DP master). This is illustrated by the table below.

Table 4-5 Relationship between the analog output values for the operating state of the PLC (CPU of the DP master) and the supply voltage L+.

Operating state of the PLC (CPU of the DP master)		Supply voltage L+ on ET 200S (power module)	Output value of the electronic module with analog outputs
POWER ON	RUN	L+ present	PLC values Until first value output: <ul style="list-style-type: none"> <li>After startup, a signal of 0 mA or 0 V is output.</li> <li>Dependent on the parameter "CPU/master STOP"</li> </ul>
		L+ missing	-
POWER ON	STOP	L+ present	Dependent on the parameter "CPU/master STOP"
		L+ missing	-
POWER OF F	-	L+ present	Dependent on the parameter "CPU/master STOP"
		L+ missing	-

### 4.4.2 Effect of the value range on the 2AO U HF analog output

The way electronic modules respond to analog outputs depends on where the output values fall within the value range. This is illustrated by the table below.

Table 4-6 Response of the analog modules, depending on where the analog output value falls within the range of values

Output value falls in ...	Output value in SIMATIC S5/S7 format
Nominal range	Value from DP master
Over-/underrange	Value from DP master
Overflow	0-signal
Underflow	0-signal
Prior to parameter assignment, or incorrect parameter assignment	0-signal

# Connecting

## 5.1 Connecting analog outputs

### Introduction

This chapter describes the factors to consider when connecting the analog outputs.

### Cables for analog signals

You should use shielded and twisted-pair cables for the analog signals. This reduces the effect of interference. You should ground the shield of the analog cables at both ends. If there are differences in potential between the cable ends, an equipotential bonding current that may interfere with the analog signals will flow across the shield. In this case, you should only ground the shield at one end of the cable.

### Analog output modules

In the case of the analog output modules there is generally galvanic isolation

- Between logic and backplane bus.
- Between the load voltage and  $M_{ANA}$ .



# Index

## 2

- 2AO U HF analog electronic module
  - Block diagram, 8
  - Properties, 7
  - Terminal assignment, 7

## A

- Analog output modules
  - Error types, 14
- Analog output modules in SIMATIC S7 format, 16

## B

- Basic knowledge requirements, 3

## C

- Cables for analog signals, 19

## D

- Disposal, 3

## I

- Internet
  - Service & Support, 4

## L

- LED display, 13

## M

- Measured value resolution, 16
- Measuring ranges with SIMATIC S7, 15

## O

- Output ranges, 16

## R

- Recycling, 3
- Response of the analog modules, 17
  - During operation, 17
  - When faults occur, 17

## S

- Scope
  - Manual, 3
- Service & Support, 4

## T

- Technical Support, 4
- Training center, 4

